

# **TENDER DOCUMENT**

**CIVIL AND ELECTRICAL WORKS FOR THE RENOVATION  
AND UPGRADATION OF PRIMARY HEALTH CENTRES INTO  
HEALTH & WELLNESS CENTRE**

**AT**

**5 LOCATIONS IN MEWAT (NUH) DISTRICT ,  
HARYANA STATE**



**PROJECTS DIVISION**

**HLL Lifecare Limited**

(A Government of India Enterprise)

Corporate Head Office, Poojappura.P.O,  
Thiruvananthapuram – 695012, Kerala, India  
Phn: 0471- 2354949, 2775588

**November 2018**

**HLL LIFECARE LIMITED**  
 (A Government of India Enterprise)  
 Projects Division  
 Corporate Head Office, Poojappura.P.O,  
 Thiruvananthapuram – 695012,  
 Kerala, India  
 Phone: 0471- 2354949, 2775588

**INVITATION FOR BIDS (IFB)**

**IFBNo: HLL/CHO/PROJ/HCD/HR-H&WC/C&E/2018-19/04A**

**Date : 16-11-2018**

HLL Lifecare Limited (HLL), a Government of India Enterprise is in the process of upgradation of Primary Health centres into Health & Wellness Centres at 9 locations in Mewat (Nuh) District at the state of Haryana. For the said project, sealed and super scribed bids are invited from competent and experienced Suppliers/Contractors who are capable to do the following work meeting the requirements as per our tender.

Sl. No	Brief Description of Item/Work	Qty	EMD in Rs
1	Civil & Electrical works for the renovation & upgradation of Primary Health centres and into Health & Wellness Centres at Mewat (Nuh) District as per Schedule of work enclosed.	As per Schedule V	Rs 76,000/-

**1. Qualification Criteria:**

- a. Bidders should have minimum **Three years experience** in the relevant field. Documentary proof for the above eligibility criteria should be submitted along with the offer.
- b. Bidders, **for Health & Wellness centre**, should have experience of having successfully completed within a period of last 3 years ending 31/10/2018 at least
  - i. One Civil & Electrical work of value not less than Rs 40 Lakhs  
Or
  - ii. Two Civil & Electrical works, each of value not less than Rs 30 Lakhs  
Or
  - iii. Three Civil & Electrical works, each of value not less than Rs 20 Lakhs

Note:- Copies of Work orders and Completion certificates issued by the Client/Authority concerned shall be submitted in proof of the same.

- c. Bidder should have satisfactorily completed at least one work for any Central/State Government Departments or Central/State PSU's or local bodies in the last three years ending 31/10/2018.

Note:- Copies of Work orders and Completion certificates issued by the Client/Authority concerned shall be submitted in proof of the same.

**2. The eligible bidder shall quote for all the Schedules as per the Schedule V. The work shall be awarded to the Qualified bidder, who quotes the lowest amount for the corresponding Wellness centre/s in total. If the bidder fails to quote for any of the schedule in the tender then their bid will be treated as non responsive.**

3. The scheduled date for issue, receipt and opening of bids is as follows.

- a) Date of issue of tender document - 16.-11-2018 onwards  
b) Last date and time for receipt of bids - up to 03-12-2018 15.00Hrs.  
c) Date and time of opening of bids - 03-12-2018, 15.30Hrs.  
d) Address for communication, receipt and place of opening of bids:

**SENIOR MANAGER (PROJECTS),**

Projects Division,

HLL Lifecare Limited (A Government of India Enterprise)

Corporate Head Office, Poojappura.P.O,

Thiruvananthapuram – 695012,

Kerala, India

Phn: 0471- 2354949, 2775588

E-mail: harikrishnankp@lifecarehll.com, choprojects@lifecarehll.com

4. The completed and sealed bid documents should be submitted to Senior Manager (Projects), in the above address along with the EMD. The outer cover should bear the Enquiry No, closing date and General description of item tendered, and the words "DO NOT OPEN BEFORE" 15.30 Hrs (IST) on ----- (Indicate the Closing Date). EMD shall be submitted in the form of demand draft drawn from a nationalized bank in favor of HLL Lifecare Limited payable at Thiruvananthapuram. Bids received after due date and time will be rejected. Any bid not accompanied by EMD will be rejected.
5. Bids will be opened in the presence of Bidders representative(s) who choose to attend on the specified date and time, at the office of HLL at the address given in Clause 3 (d) above.
6. In the event of the date specified for bid receipt and opening being declared as a closed holiday for the above purchaser's office, the due date for submission of bids and opening of bids will be the following working day at the appointed times.
7. HLL may, at its discretion, extend this deadline for submission of bids by amending the Bid Documents or any other reasons, in which case all rights and obligations of HLL and Bidders previously subject to the deadline will thereafter be subject to the deadline as extended.

8. HLL will not be held responsible for the postal delay, if any, in the delivery of the bidding document or the non-receipt of the same. Bids sent by Telex/Fax/Telegraph will not be accepted.
9. The EMD should be enclosed in a separate envelope and super scribed as “EMD” and to be attached in the main cover.
10. SSI/MSME units interested in availing exemption from payment of EMD should submit a valid copy of their registration certificate issued by the concerned DIC or NSIC. But the party has to provide Security Deposit as per the tender conditions, if the work is awarded to them.
11. Even though the bidder meet the above qualifying criteria, they are subject to be disqualified if they have:

Record of poor performance such as abandoning the works, not properly completing the contract, inordinate delays in completion, litigation history, or financial failures etc...

12. The Bid must include the following information;
  - a. Enquiry No.
  - b. EMD
  - c. Promised Delivery/Completion Schedule
  - d. Price Schedule in Format For Quoting (Schedule V - for 5 locations)
  - e. All other documents/certificate/information as specified in the bid document.
13. In addition to the invitation for bids, the bidding documents include the following schedules.

Schedule I	-	Conditions of Contract
Schedule II	-	Acceptance Form
Schedule III	-	Capability Certificate
Schedule IV	-	Performance Statement
Schedule V	-	Schedule of Works (5 locations)
Schedule VI	-	Drawings

14. The company reserves the right to club or split the items of works, change the qualifying criteria at their discretion and to reject or cancel the Invitation for bids without assigning any reason thereof.

**SENIOR MANAGER (PROJECTS)**

## **SCHEDULE I**

### **CONDITIONS OF CONTRACT**

#### **1) PRICE**

The price quoted should be inclusive of all material cost, loading and unloading charges, all applicable taxes and other levies, insurance etc. The **Schedule of work** is enclosed as **Schedule V (for 5 locations)**.

Price quoted should be firm without any escalation till the order is completely executed.

#### **2) TAXES/DUTIES/LEVIES**

The contractor shall be entirely responsible for all applicable taxes including GST, duties, license fees etc. incurred until successful completion of contract.

#### **3) ESCALATION**

The rates quoted by the Contractor in the contract documents shall be final and shall not be subjected to any change due to the increase in works awarded or wages or inflation in the cost of materials or any other price variations due to any reason during the stipulated time period of the contract or during the extended time period of completion.

Rates quoted should be inclusive of all cost of materials, Tools/Equipments wellness centre or charges, conveyance to site, handling charges, loading and unloading charges, hiring charges, clearing of debris, statutory payments etc.

#### **4) COMPLETION TIME**

Time is the essence of the Contract. The total time allotted for completion of works in all respects for all the sites is 4 Weeks from the date of issue of the Letter Of Intent or Work Order. This stands clear irrespective of the number of wellness centres awarded to each Party.

#### **5) PAYMENT TERMS**

The contractor can submit two running account bills during the work period and payment made as below:

- a) 50% of the total value of work may be released upon the completion of 60 % of the work recommended by State Incharge (P&S, HLL) and approved by Project Engineer (P&S, HLL)/ Manager (P&S, HLL).
- b) Balance 50% will be paid along with the final bill only after submission of Work Completion certificate issued by the concerned hospital and approved by Project Engineer (P&S, HLL)/ Manager (P&S, HLL).

5% amount of the Bill will be retained as retention money and will be released only after the Defect liability period of 12 months.

Final Bill to be submitted detailing the work description, quantity and rate as per the Work Order. Payment will be made against actual measurements recorded and certified jointly by State In Charge (P&S, HLL) and the Contractor 's representative, counter signed by Project Engineer (P&S, HLL)/ Manager (P&S, HLL). The work completion certificate will be issued by the concerned centres/hospitals and it is the responsibility of the contractor to collect the completion certificate certified by the concerned hospital authority & HLL authorities and submit to HLL for balance 50% payment

The running account bills are to be submitted detailing the work description, quantity and rate as per the Work Order. Payment will be made against actual measurements recorded and certified jointly by State in charge (P&S, HLL) and the Contractor's representative. For supply of capital items, duly certified delivery challan/supporting documents such as Warranty Certificates etc. shall be enclosed along with bill.

Tax Deduction: All statutory deductions like GST, Income Tax, Works Contract Tax, E.S.I., P.F. or any other government-imposed liabilities shall be borne by the Contractor (as applicable at the time of execution of job) and shall be deducted from each bill submitted by the Contractor.

## **6) SECURITYDEPOSIT**

On receipt of notification of award, simultaneously with the execution of the contract, successful bidder shall furnish a Security deposit in the form of a Demand Draft from a nationalized bank drawn in favour of HLL Lifecare Limited, Thiruvananthapuram payable at Thiruvananthapuram or a Bank Guarantee from a nationalized bank, for an amount equal to 5% of the total contract value as Security Deposit for his faithful execution of contract. The Security deposit should be valid until successful completion of the contract and acceptance of the Equipment/works by the Purchaser/Owner and will be released after acceptance of the Equipment/works by the Purchaser/Owner. In case of a delay in the works the validity of security deposit shall be extended.

Within 10 days of the receipt of notification of award from the Purchaser/Owner; the successful Bidder shall furnish the security deposit in the form of a Demand Draft or Bank Guarantee in the security deposit form to be sent along with the Notification of Award.

The EMD submitted by the successful bidder shall be converted to Security Deposit and the bidder shall be allowed to remit the balance amount.

Failure of the successful Bidder to accept the notification of award or submission of security deposit within the timeframe shall constitute sufficient grounds for the annulment of the award and forfeiture of the EMD, in which even the Purchaser/Owner may make the award to the next lowest evaluated bidder or call for new bids.

## Forfeiture of Security Deposit:

If the successful bidder/ Contractor fails to supply the ordered material at the rate finalized or execute the work and / or supplies only part quantity / partially execute the work or fails to comply with the terms and conditions of the purchase order / work order the security deposit furnished will be forfeited / Bank Guarantee encashed..

## 7) EARNESTMONEY

Each bid must be accompanied by E.M.D.

The EMD is required to protect the Purchaser/Owner against risk of Bidder's conduct, which would warrant the security's forfeiture.

- a. The EMD shall be in the form of cash deposit or demand draft from a nationalized bank drawn in favour of HLL Lifecare Limited, Thiruvananthapuram payable at Thiruvananthapuram.
- b. E.M.D. from unsuccessful bidders will be returned after the acceptance of order by the L1 party.
- c. In the case of successful bidder, the Earnest Money will be returned after signing the contract, and submission of Security Deposit, which they will have to offer for the faithful execution of the contract.

The EMD may be forfeited:

- (a) If a Bidder withdraws its bid during the period of bid validity specified by the Bidder on the Bidding Document; or
- (b) In case of the successful Bidder, if the Bidder fails:
  - (i) to sign the Contract
  - (ii) to furnish security deposit

SSI/MSME units interested in availing exemption from payment of EMD should submit a valid copy of their registration certificate issued by the concerned DIC or NSIC.

## 8) INDEMNIFICATION CLAUSE

The Bidder shall indemnify and hold harmless the Owner/Purchaser from and against the below mentioned:

- i. All claims, demands, action, proceedings, losses, damages, liabilities, cost, charges, expenses or obligations that are occasioned or may occasion to HLL as a result of our non-payment of any statutory dues levied/leviable on the Contractor or the Contractor committing breach of any the rules, regulations, orders, directives, instructions that may be issued by any authority under various Laws, PF, ESI Acts and all other applicable Laws/Acts/Rules or any other Statute or Laws for the time being in force
- ii. Any damages, loss or expenses due to or resulting from any negligence or breach of duty on our part or on the part of Sub-Contractor/s, if any, servants or agents of the Bidder.
- iii. Claims, if any, of the employee or the Contractor and its Sub Contractor/s, under the Workmen's Compensation Act, 1923 and Employer's Liability Act 1938 or any other Laws rules and regulations in force for the time being in India and any acts replacing and/or amending the same or any of the same as may be in force at the time and under any law in respect of injuries to persons or property arising out of and in the course of the execution of the contract work and / or arising out of and in the course of employment of any workmen /employee.
- iv. Any non - compliance or improper compliance of statutes, rules and regulations which are applicable to HLL and also to the Contractor and to the employees , in respect of (a) Employees' Provident Fund and Miscellaneous Provision Act, 1952,(b)Employees State Insurance Act, 1948,(c)Minimum Wages Act, 1948 (d) Payment of Wages Act, 1936 (e) Bonus Act, 1965 (f) Workmen's Compensation Act, 1923 and / or any other laws which may become applicable in respect of the Contract/ Agreement between HLL and the Bidder.
- v. Any Act or omission by us or our Sub-contractor/s, if any, our /their servants or agents which may involve any loss, damages, liability, civil or criminal action.
- vi. To protect against all claims for damage caused due to non-obtaining of insurance policy during the project period.



**9) DEFECT LIABILITY PERIOD:**

The defect liability period of the work shall be 12 months from the date of completion of the work and this date will start from successful completion and handing over. If any damage or defect occurs in the work during this period then the Contractor shall rectify the damage or defect at his own expense to the satisfaction of the Purchaser/Owner. If the Contractor fails to do so, then the Purchaser/Owner shall have the authority to get the work done by other means and the expenditure incurred shall be recovered from the Contractor.

Even if Inspection and/or tests are fully carried out by Purchaser/Owner or their representatives, the Contractor is not absolved to any degree of his responsibility to ensure that all equipment fabricated comply strictly with the requirements as per specifications given in the order, and the Purchaser/Owner shall be free to point out any defect till the defect liability period is over.

**10) FORCE MAJEURE**

- a. Neither the Contractor nor the Purchaser/Owner shall be considered in default in the performance of their obligations as per the Contract so long as such performance is prevented or delayed because of strikes, war, hostilities, revolution, civil commotion, epidemics, accidents, fire, cyclone, flood or because of any law and order proclamation, regulation or ordinance of Government or subdivision thereof or because of any act of God. The proof of existence of force majeure shall be provided by the party claiming it to the satisfaction of the other.
- b. The Contractor shall advise Purchaser/Owner initially by a Fax, followed by post, the beginning and end of any of the above causes of delay, failing which Purchaser/Owner shall not be liable to consider delays due to the above reasons. Notice as stated above should be given even in case where only the Contractor's bids are under the consideration of the Purchaser/Owner and no acceptance of the same has been given and detailed order issued.
- c. In the event of definite delay even if arising out of reasons due to force majeure, Purchaser/Owner shall have the right at their discretion to cancel the Order or part of the Order without any liability on their part to make any payment to the Contractor while reserving the right to claim refund of and any payment if advanced or paid to Contractor.

**11) DELAY IN WORK EXECUTION DUE TO REASONS BEYOND CONTRACTOR'S CONTROL**

Force majeure: If the execution of work is delayed due to force majeure, then Purchaser/Owner as per the affected period may extend the timeperiod.

In case work is delayed due to non-availability of stores supplied by Owner or any decision by Owner holding the progress of work, the contractor then upon any such happening causing delay shall immediately but not later than 10 days, give notice thereof in writing to the Owner, but nevertheless use constantly his best effort to prevent or make good delay. The Owner may in his discretion grant such extension of time as may appear reasonable to him and the same shall be communicated to the contractor in writing and shall be final and binding on him and the contractor shall be bound to complete the work within such extended time.

**12) LIQUIDATED DAMAGES FOR DELAYS**

If the work is not completed and handed over to the Purchaser/Owner within the time stipulated in the Order, Purchaser/Owner may at their option, either (1) recover from the Contractor liquidated damages at the rate of 0.5 % of the total contract value for every day of delay, subject to a maximum of 10 % of the total contract value, or (2) at the risk and cost of the Contractor and without prejudice to the other remedies/rights as per the Contract, terminate the order wholly or partially and complete it themselves or reassign it to other contractors.

**13) SPECIAL INSTRUCTIONS**

1. **The bidder shall visit the site before quoting for the work and also take their own assessments before quoting of bids.**
2. The bidders shall quote for all the locations & all schedules in the tender document as per the Schedule V and his/her own eligibility as per the pre qualification criteria. The work shall be awarded to the Qualified bidder, who quotes the lowest amount in total. If the bidder fails to quote any of the schedule in the tender then their bid will be treated as non responsive.
3. All pages of the bid, except for un-amended printed literature shall be signed by the person or persons signing the bid. The seal of the company shall be stamped in all pages.
4. Bids shall be made in English. The bid shall contain no interlineations, erasures or overwriting except as necessary to correct errors made by the Bidder, in which case such corrections shall be signed by the person or persons signing the bid.
5. To assist in the examination, evaluation and comparison of bids, the Owner may, at its discretion, ask the bidder for a clarification of its bid. The request for clarification and the response shall be in writing and no change in the rate or substance of the bid shall be sought, offered or permitted.
6. Arithmetical errors will be rectified on the following basis. If there is a discrepancy between the unit price and the total price that is obtained by multiplying the unit

**HLL LIFECARE LIMITED**

- i. price and quantity, the unit price shall prevail and the total price shall be calculated. If there is a discrepancy between the words and figures of unit price, the amount in words of unit price shall prevail.
7. Prior to the detailed evaluation, the Owner will determine the substantial responsiveness of each bid to the bidding documents. For purposes of these clauses, a substantially responsive bid is one, which conforms to specifications and all the terms and conditions of the bidding documents without material deviation. The Owner's determination of a bid's responsiveness is to be based on the contents of the bid itself without recourse to extrinsic evidence.
8. The Owner's determination as to the substantial responsiveness or otherwise of each bid or consideration of a minor informality or non-conformity or irregularity is final and conclusive.
9. The Owner reserves the right to negotiate with the lowest evaluated responsive bidder.
10. The Owner will award the Contract to the successful Bidder whose bid has been determined to be substantially responsive and has been determined as the lowest evaluated bid provided further that the Bidder is determined to be qualified to perform the Contract satisfactorily for the items offered.
11. Prior to the expiration of the period of bid validity, the Owner will notify the successful Bidder in writing by or cable or telex or fax, to be confirmed in writing by post, that its bid has been accepted. The notification of award may be sent in the form of Letter of Intent and/or Work order.
12. The signed acceptance of the notification of award by the Contractor will constitute a concluded contract.
13. The work should be carried out without causing any inconvenience to the public and shall ensure that no damages are caused to the existing site premises.
14. During the execution of work, the contractor or authorized representative should be present atsite.
15. All Materials, Equipment's/ Tools required for the work should be arranged by the contractor and brought to site for the timely completion of the work.
16. The materials used shall be as per specification and of good quality.
17. The Contractor has to arrange necessary insurance coverage for the machine, workmen etc. deployed by him. He shall arrange all safety measures to protect his workmen and also the properties of HLL/Hospital Building. The work site safety of all employees, their ESI, PF etc will have to be borne by the contractor.
18. The work should be carried out in truly professional manner, neatly finished with proper line, level and plumb. Cleanliness and finishing of the job is of utmost importance. Hence the job should be done most carefully with best workmanship.

**HLL LIFECARE LIMITED**

- i. For all finishing jobs samples should be approved from the Purchaser/Owner before completely executing the work.
19. The Purchaser/Owner should be immediately informed for any discrepancy in drawings, specifications and instructions in the execution of job before actual execution of particular item having discrepancy.
20. Any item found to be having been executed with poor workmanship then the Contractor shall have to rectify /reconstruct the work as specified by Purchaser/Owner. No extra charge will be admissible in such case. If CONTRACTORS fails to do so, the Purchaser/Owner reserved the right to rectify/reconstruct the work through some other agency at the expenses of Contractor.
21. The schedule of activities as submitted by the Contractor shall have to be strictly adhered to. Regular progress reports shall have to be submitted by the Contractor giving all details for monitoring of the schedule.
22. The Contractor shall make initial drawings/layouts (as per site conditions) and get it approved by HLL before execution.
23. Special care is to be taken for cleanliness of the site. After the end of day's work, the site should be cleaned immediately.
24. The Contractor shall have to co-operate with the agencies executing other works in the same area.
25. While executing the work, the Contractor shall ensure safety and security of the property of the Purchaser/Owner so as to avoid theft etc.
26. Measurement & Payment terms:
  - i. The method of measurement of completed work shall be in accordance with the standard measurement. Payment will be made on satisfactory completion of work as per the order. Interim or running account bills shall be submitted by the contractor for the work executed on the basis of such recorded measurements in the format of HLL. All such interim payments shall be regarded as payment by way of advances against final payment only, and shall not preclude the requiring of bad, unsound and imperfect or unskilled work to be rejected, removed, taken away and reconstructed or re erected. Any certificate given by the officer relating to the work done or materials delivered forming part of such payment, may be modified, or corrected by any subsequent such certificate(s) or by the final certificate and shall not by itself be conclusive evident that any work or material so which it relates is /are in accordance with the contract and certificate. Any such interim payment,/any part there of shall not in any respect conclude, determine or affect in any way powers of the engineer in charge under the contract or any of such payment s be treated as final settlement and adjustment of accounts or in any way vary or affect the contract.
27. If contractor is executing any extra items as per direction of Engineer in charge / Officer in charge, the rates shall be worked out as per the latest CPWD Schedule

- i. of Rates and in case, the item is not included in the CPWD schedule, the rate shall be arrived as per prevailing Market rates.
28. The Quantity shown in the schedule is an approximate estimated quantity. No rate revision will be entertained if the quantity increases/decreases due to the site condition while executing the work.
29. Water and Electricity: The contractor shall make his own arrangement for water and electricity required for the works. HLL will not be responsible for the supply of either electricity or water.
30. During the execution of work, the contractor or authorized representative/s at least one person having technical qualification should be present at site.
31. The contractor shall comply with by-laws and regulation of local and statutory authorities having jurisdiction over the work and shall be responsible for payment of all statutory fees and other charges and the giving and receiving of all necessary notices and the Owner shall be kept informed of the said compliances with by-laws, payment made, notices issued and received.
32. Electrical
  - i. The work shall be carried out by a contractor holding valid licence issued by the State Government/Competent Authority for carrying out installation work of all voltage classes involved, under direct supervision of the persons holding valid certificates issued or recognized by the state government/competent authority.
33. Final payment shall be paid only after clearing the site as per direction of Engineer-in-charge/ Officer incharge.

#### **14) CORRESPONDENCE**

All correspondence relating to this Order shall be in English, to:

**SENIOR MANAGER (PROJECTS),**  
PROJECTS DIVISION,  
HLL LIFECARE LIMITED (A Government of India Enterprise)  
Corporate Head Office, Poojappura.P.O,  
Thiruvananthapuram – 695012, Kerala, India  
Phn: 0471- 2354949, 2775588  
E-mail: choprojects@lifecarehll.com, harikrishnankp@lifecarehll.com

#### **15) SETTLEMENT OFDISPUTES**

Arbitration shall not be a means of settlement of any dispute or claim arising out of the contract relating to the work. Any disputes or difference arising between the parties with respect to the performance of any part of this agreement or anything connected therewith, etc shall as far as possible be mutually settled by the process of dialog and negotiation.

The Courts at Thiruvananthapuram alone shall have jurisdiction in respect of settlement of any matter arising out or in connection with the contract.

**SCHEDULE II**

**ACCEPTANCE FORM**

*(To be submitted in the letter pad of the firm indicating full name and address, telephone & fax numbers etc.)*

From

To

Senior Manager (Projects),  
Projects Division,  
HLL Lifecare Limited (A Government of India Enterprise)  
Corporate Head Office, Poojappura.P.O,  
Thiruvananthapuram – 695012,  
Kerala, India  
Phn: 0471- 2354949, 2775588  
E-mail: harikrishnankp@lifecarehll.com, choprojects@lifecarehll.com

Dear Sir,

I / We, hereby offer to supply/construct/erect/install/commission the work as detailed in schedule/drawings hereto or such portion thereof as you may specify in the acceptance of Bid at the price given in the price bid and agree to hold this offer open till 90 days after the date of bid opening prescribed by the purchaser/Owner. I/We have understood the terms and conditions mentioned in the invitation for bid and Conditions of Contract furnished by you and have thoroughly examined the specifications quoted in the bid document/drawings hereto and are fully aware of the nature of the scope of work required and my/our offer is to comply strictly in accordance with the requirement and the terms and conditions mentioned above.

Yours faithfully,

**SIGNATURE OF THE BIDDER**

**SCHEDULE III**

**CAPABILITY CERTIFICATE**

*(To be submitted in the letter pad of the firm indicating full name and address, telephone & fax numbers etc.)*

I/We have the financial capability to execute the work and complete the same within the specified time period (4 Weeks). The delay, if any, in taking measurements, certification of bills, submission of bills and release of payments will not affect the progress and completion of work. I have read all the terms and conditions of the tender document including payment terms and confirm my acceptance of the same.

**SIGNATURE OF THE BIDDER WITH SEAL**

**SCHEDULE IV**

**PROFORMA FOR PERFORMANCE STATEMENT**

Proforma for Performance Statement (for a period of last 3 years)

Name of the Tenderer:.....

Name & Address of the Tenderer / Service Provider:.....  
 .....

Order placed by (Full Address of Company / Consignee)	Order No. and Date	Description and quantity of ordered work and service	Value of order	Date of Completion of Contract		Remarks indicating reasons for delay, if any	Have the works been satisfactorily completed?  (Attach a documentary proof from the client)
				As per Contract	Actual		

We hereby certify that if at any time, information furnished by us is proved to be false or incorrect, we are liable for any action as deemed fit by the Company in addition to forfeiture of earnest money.

Signature and Seal of the Bidder.....

.....



## SCHEDULE V

### RENOVATION OF CIVIL & ELECTRICAL WORKS FOR UPGRADATION OF PRIMARY HEALTH CENTRES AT MEWAT (NUH) DISTRICT IN THE STATE OF HARYANA

#### ABSTRACT PRICE BID

Site. No.	Location	Details	Amount Quoted (Rs)
1	PHC Ujhina	Total Civil and Electrical Work	
		GST @ 18 %	
		Sub Total (a)	
2	PHC Ghasera	Total Civil and Electrical Work	
		GST@ 18 %	
		Sub Total (b)	
3	PHC Sudaka	Total Civil and Electrical Work	
		GST@ 18 %	
		Sub Total (c)	
4	PHC Nagina	Total Civil and Electrical Work	
		GST@ 18 %	
		Sub Total (d)	
5	PHC Biwan	Total Civil and Electrical Work	
		GST@ 18 %	
		Sub Total (e)	
Total Rs = Sub total (a+b+c+d+e) including GST @ 18%			

Total words in Rupees: \_\_\_\_\_

Bidder has to quote as per the Make/Brand specified in the BOQ, proposed to use for the project, and has to marks the Make/Brand in the quote / price schedule.

SEAL OF THE BIDDER

Date:

SIGNATURE  
NAME AND ADDRESS OF BIDDER

**1) SCHEDULE OF WORK FOR PUBLIC HEALTH CENTRE AT UJHINA**

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Civil Work</b>					
<b>MASONRY WORK</b>					
1	Half brick masonry with common burnt clay F.P.S. (non modular) bricks of class designation 7.5 in superstructure above plinth level up to floor V level. Cement mortar 1:3 (1 cement :3 coarse sand)	3	M.SQ		
<b>FLOORING</b>					
2	Providing and fixing 1st quality ceramic glazed floor tiles conforming to IS : 15622 (thickness to be specified by the manufacturer ) of approved make in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge in skirting, risers of steps and dados over 12 mm thick bed of cement Mortar 1:3 (1 cement: 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
3	Providing and fixing Ist quality ceramic glazed wall tiles conforming to IS: 15622 (thickness to be specified by the manufacturer), of approved make, in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge, in skirting, risers of steps and dados, over 12 mm thick bed of cement mortar 1:3 (1 cement : 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm, including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
<b>PLASTERING</b>					
4	15 mm cement plaster on rough side of single or half brick wall finished with a floating coat of neat cement of mix : 1:3 (1 cement: 3 fine sand)	8	M.SQ		
<b>PAINTING</b>					
5	Distempering with 1st quality acrylic washable distemper (ready made) of approved manufacturer and of required shade and colour complete. as per manufacturer's specification. One or more coats on old work	2256	M.SQ		
6	Painting wood work with Deluxe Multi Surface Paint of required shade. Two or more coat applied @ 0.90 ltr/10 sqm over an under coat of primer applied @0.75 ltr/10 sqm of approved brand and manufacture	26	M.SQ		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
7	Painting Steel work with Deluxe Multi Surface Paint to give an even shade. Two or more coat applied @ 0.90 ltr/ 10 sqm over an under coat of primer applied @ 0.80 ltr/ 10 sqm of approved brand and manufacture	33	M.SQ		
8	Providing and applying plaster of paris putty of 2 mm thickness over plastered surface to prepare the surface even and smooth complete.	248	M.SQ		
9	Removing white or colour wash by scrapping and sand papering and preparing the surface smooth including necessary repairs to scratches etc. complete	3687	M.SQ		
10	Finishing walls with Acrylic Smooth exterior paint of required shade: Old work (Two or more coat applied @ 1.67 ltr/ 10 sqm) on existing cement paint surface	1431	M.SQ		
<b>DISMANTLING</b>					
11	Dismantling plastered brickwalls in cement mortar including cleaning, stacking the useful materials as directed by engineer-in-charge and dumping the dismantled debris as indicated at site, levelling, consolidating, all complete as directed and disposing the debris away from site all complete as directed.	2	M.CUBE		
12	Dismantling the existing RCC concrete including cutting the reinforcement, stacking the useful materials as directed by engineer-in-charge, dumping the dismantled debris as indicated at site, leveling, consolidating, all complete as directed and disposal of debris away from site all complete.	1	M.CUBE		
13	Dismantling Aluminium partition including disposing the debris away from site as directed by engineer in charge all complete.	4	M.SQ		
14	Dismantling of flushing cistern of all types (C.I./PVC/Vitrious China) including stacking of useful materials near the site and disposal of unserviceable materials within 50 metres lead.	1	EACH		
15	Repairs to plaster of thickness 12 mm to 20 mm in patches of area 2.5 sq. meters and under, including cutting the patch in proper shape, raking out joints and preparing and plastering the surface of the walls complete, including disposal of rubbish to the dumping ground, all complete as per directions of Engineer-In-Charge. With cement mortar 1:4 (1cement: 4 coarse sand)	21	M.SQ		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
16	Providing wood work in frames of doors, windows, clerestory windows and other frames, wrought framed and fixed in position with hold fast lugs or with dash fasteners of required dia & length ( hold fast lugs or dash fastener shall be paid for separately). Kiln seasoned and chemically treated hollock wood	0.100	CUM		
17	Providing and fixing ISI marked flush door shutters conforming to IS : 2202 (Part I) non-decorative type, core of block board construction with frame of 1st class hard wood and well matched commercial 3 ply veneering with vertical grains or cross bands and face veneers on both faces of shutters: 35 mm thick including ISI marked Stainless Steel butt hinges with necessary screws	5	M.SQ		
18	Renewing glass panes, with wooden fillets wherever necessary: Float glass panes of thickness 4 mm	10	M.SQ		
19	Providing and applying fibre reinforced elastomeric liquid water proofing membrane with resilient acrylic polymers having Sun Reflectivity Index (SRI) of 105 on top of concrete roof in three coats @10.76 litre/ 10 sqm. One coat of self-priming of elastomeric waterproofing liquid (dilution with water in the ratio of 3:1) and two coats of undiluted elastomeric waterproofing liquid (dry film thickness of complete application/ system not less than 500 microns). The operation shall be carried out after scrapping and properly cleaning the surface to remove loose particles with wire brushes, complete in all respect as per the direction of Engineer-in-Charge.	686	M.SQ		
20	Dismantling Tile Flooring and Walls & Roof and disposing the debris away from site all complete as directed.	42	M.SQ		
<b>DESIGN PRINTED TILES</b>					
21	Providing and laying required size DESIGN PRINTED for display of Logo glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true & even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)  The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)	8	M.SQ		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
22	<p>Providing and laying required size DESIGN PRINTED for Windows &amp; Door Borders glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true &amp; even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)</p> <p>The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)</p>	34	M.SQ		
23	Provide all final cleaning including for the Work of assigned Contractors and remove all waste, debris, rubbish, tools, equipment, machinery and surplus materials. Clean all sight exposed surfaces; leave work clean and ready for occupancy.		LS		
<b>PLUMBING</b>					
24	Renewing and repairing plumbing & sanitary items in toilets including making good all damages WC Seat, Gully Trap, Pipe Lines, Flush cistern, flush pipes, PVC pillar taps, PVC Waste Pipes, Pipelines, gate valve and Gratings of approved brand and manufacturer.		LS		
<b>Sub Total (Civil Work)</b>					
<b>Electrical Work</b>					
1	<b>Point wiring in PVC conduit with modular type switch.</b>				
	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable in surface / recessed medium class PVC conduit, with modular switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required. switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required.				
	Group C	12	Point		
2	<b>Wiring through PVC conduit</b>				
	Wiring for circuit/submain wiring along with earth wire with the following sizes of FR PVC insulated copper conductor, single core cable in surface/recessed medium class PVC conduit as required.(Make:Havells/Finolex/V-guard/Polycab)				
a	2X1.5 sq.mm + 1X1.5 sq.mm earth wire	30	Metre		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
3	<b>Modular type switch/socket:</b>				
	Supplying and fixing following modular switch/socket on the existing modular plate & switch box including connections but excluding modular plate etc as required. (Make: Legrand/Havells/HPL)				
a	5/6 Amps switch	3	Each		
b	3 pin 5/6 Amp socket outlet	3	Each		
c	15/16 Amps switch	2	Each		
d	6pin 15/16 Amps (universal) socket outlet	2	Each		
4	<b>S/F PVC conduit:</b>				
	Supplying and fixing of following sizes of medium class PVC conduit/Casing Cap G along with accessories in surface/recess including cutting the wall and making good the same in case of recessed conduit as required.(ISI Make)				
a	20 mm	200	Metre		
	<b>Installation Testing &amp; Commissioning</b>				
5	<b>ITC Fluorescent fitting directly on surface:</b> Installation, testing and commissioning of pre-wired, fluorescent fitting / compact fluorescent fitting/LED of all types, complete with all accessories and tube etc. directly on ceiling/ wall, including connection with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable and earthing etc. as required.	5	Each		
6	<b>ITC Ceiling fan/Wall fan:</b> Installation, testing and commissioning of ceiling fan, including wiring the down rods of standard length (upto 30 cm) with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable etc. as required.	2	Each		
7	Supplying and fixing two module stepped type electronic fan regulator on the existing modular plate switch box including connections but excluding modular plate etc. as required.	2	Each		
8	Supply of 15W LED tube fitting sleek with decorative end cap, powder coated CRCA steel channel complete with all electrical accessories like electronic ballast, lamp holder, 28W LED lamp etc complete as required. (Philips / Wipro /HAVELLS)	12	Each		
9	Supply and installation of 18 W CFL with its all accessories.[ISI MAKE]	18	Each		
10	Supply and installation of wall fan, white colour, 5 star rated as per BEE complete with blades, casing , wall mounting accessories etc(Make Havells/bajaj/usha/V-guard/crompton)	2	Each		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	<b>Miscellaneous Items</b>				
11	<b>CABLE SUPPLY</b>				
	Supplying the following PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade as per CPWD standards as required. <b>(Make:Havells/ Glostar/Nicco/Finolex/Polycab)</b>				
	2 X 4 sq. mm + 1 X 4 sq. mm earth wire ( 3 Nos. of 4 Sq.mm wire)	3	Metre		
	<b>Sub Total (Electrical Work)</b>				
	<b>Total (Civil &amp; Electrical Work)</b>				
	<b>GST @ 18%</b>				
	<b>Grand Total ( Including GST @ 18%)</b>				

**2.SCHEDULE OF WORK FOR PRIMARY HEALTH CENTREAT GHASERA**

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Civil Work</b>					
<b>MASONRY WORK</b>					
1	Half brick masonry with common burnt clay F.P.S. (non modular) bricks of class designation 7.5 in superstructure above plinth level up to floor V level. Cement mortar 1:3 (1 cement :3 coarse sand)	3	M.SQ		
<b>FLOORING</b>					
2	Providing and fixing 1st quality ceramic glazed floor tiles conforming to IS : 15622 (thickness to be specified by the manufacturer ) of approved make in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge in skirting, risers of steps and dados over 12 mm thick bed of cement Mortar 1:3 (1 cement: 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm including pointing in white cement mixed with pigment of matching shade complete.	7	M.SQ		
3	Providing and fixing Ist quality ceramic glazed wall tiles conforming to IS: 15622 (thickness to be specified by the manufacturer), of approved make, in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge, in skirting, risers of steps and dados, over 12 mm thick bed of cement mortar 1:3 (1 cement : 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm, including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
<b>PLASTERING</b>					
4	15 mm cement plaster on rough side of single or half brick wall finished with a floating coat of neat cement of mix : 1:3 (1 cement: 3 fine sand)	8	M.SQ		
<b>PAINTING</b>					
5	Distempering with 1st quality acrylic washable distemper (ready made) of approved manufacturer and of required shade and colour complete. as per manufacturer's specification. One or more coats on old work	2880	M.SQ		



Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
6	Painting wood work with Deluxe Multi Surface Paint of required shade. Two or more coat applied @ 0.90 ltr/10 sqm over an under coat of primer applied @0.75 ltr/10 sqm of approved brand and manufacture	26	M.SQ		
7	Painting Steel work with Deluxe Multi Surface Paint to give an even shade. Two or more coat applied @ 0.90 ltr/ 10 sqm over an under coat of primer applied @ 0.80 ltr/ 10 sqm of approved brand and manufacture	23	M.SQ		
8	Providing and applying plaster of paris putty of 2 mm thickness over plastered surface to prepare the surface even and smooth complete.	284	M.SQ		
9	Removing white or colour wash by scrapping and sand papering and preparing the surface smooth including necessary repairs to scratches etc. complete	4536	M.SQ		
10	Finishing walls with Acrylic Smooth exterior paint of required shade: Old work (Two or more coat applied @ 1.67 ltr/ 10 sqm) on existing cement paint surface	1656	M.SQ		
<b>DISMANTLING</b>					
11	Dismantling plastered brickwalls in cement mortar including cleaning, stacking the useful materials as directed by engineer-in-charge and dumping the dismantled debris as indicated at site, levelling, consolidating, all complete as directed and disposing the debris away from site all complete as directed.	2	M.CUBE		
12	Dismantling the existing RCC concrete including cutting the reinforcement, stacking the useful materials as directed by engineer-in-charge, dumping the dismantled debris as indicated at site, leveling, consolidating, all complete as directed and disposal of debris away from site all complete.	1	M.CUBE		
13	Dismantling Aluminium partition including disposing the debris away from site as directed by engineer in charge all complete.	4	M.SQ		
14	Dismantling of flushing cistern of all types (C.I./PVC/Vitrious China) including stacking of useful materials near the site and disposal of unserviceable materials within 50 metres lead.	1	EACH		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
15	Repairs to plaster of thickness 12 mm to 20 mm in patches of area 2.5 sq. meters and under, including cutting the patch in proper shape, raking out joints and preparing and plastering the surface of the walls complete, including disposal of rubbish to the dumping ground, all complete as per directions of Engineer-In-Charge. With cement mortar 1:4 (1cement: 4 coarse sand)	39	M.SQ		
16	Providing wood work in frames of doors, windows, clerestory windows and other frames, wrought framed and fixed in position with hold fast lugs or with dash fasteners of required dia & length ( hold fast lugs or dash fastener shall be paid for separately). Kiln seasoned and chemically treated hollock wood	0.100	CUM		
17	Providing and fixing ISI marked flush door shutters conforming to IS : 2202 (Part I) non-decorative type, core of block board construction with frame of 1st class hard wood and well matched commercial 3 ply veneering with vertical grains or cross bands and face veneers on both faces of shutters: 35 mm thick including ISI marked Stainless Steel butt hinges with necessary screws	5	M.SQ		
18	Renewing glass panes, with wooden fillets wherever necessary: Float glass panes of thickness 4 mm	12	M.SQ		
19	Providing and applying fibre reinforced elastomeric liquid water proofing membrane with resilient acrylic polymers having Sun Reflectivity Index (SRI) of 105 on top of concrete roof in three coats @10.76 litre/ 10 sqm. One coat of self-priming of elastomeric waterproofing liquid (dilution with water in the ratio of 3:1) and two coats of undiluted elastomeric waterproofing liquid (dry film thickness of complete application/ system not less than 500 microns). The operation shall be carried out after scrapping and properly cleaning the surface to remove loose particles with wire brushes, complete in all respect as per the direction of Engineer-in-Charge.	868	M.SQ		
20	Dismantling Tile Flooring and Walls & Roof and disposing the debris away from site all complete as directed.	42	M.SQ		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	<b>DESIGN PRINTED TILES</b>				
21	<p>Providing and laying required size DESIGN PRINTED for display of Logo glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true &amp; even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)</p> <p>The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)</p>	8	M.SQ		
22	<p>Providing and laying required size DESIGN PRINTED for Windows &amp; Door Borders glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true &amp; even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)</p> <p>The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)</p>	34	M.SQ		
23	<p>Provide all final cleaning including for the Work of assigned Contractors and remove all waste, debris, rubbish, tools, equipment, machinery and surplus materials. Clean all sight exposed surfaces; leave work clean and ready for occupancy.</p>		LS		
<b>PLUMBING</b>					
24	<p>Renewing and repairing plumbing &amp; sanitary items in toilets including making good all damages WC Seat, Gully Trap, Pipe Lines, Flush cistern, flush pipes, PVC pillar taps, PVC Waste Pipes, Pipelines, gate valve and Gratings of approved brand and manufacturer.</p>		LS		
<b>Sub Total (Civil Work)</b>					

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Electrical Work</b>					
1	<b>Point wiring in PVC conduit with modular type switch.</b>				
	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable in surface / recessed medium class PVC conduit, with modular switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required. switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required.				
	Group C	12	Point		
2	<b>Wiring through PVC conduit</b>				
	Wiring for circuit/submain wiring along with earth wire with the following sizes of FR PVC insulated copper conductor, single core cable in surface/recessed medium class PVC conduit as required.(Make:Havells/Finolex/V-guard/Polycab)				
a	2X1.5 sq.mm + 1X1.5 sq.mm earth wire	30	Metre		
3	<b>Modular type switch/socket:</b>				
	Supplying and fixing following modular switch/socket on the existing modular plate & switch box including connections but excluding modular plate etc as required. (Make: Legrand/Havells/HPL)				
a	5/6 Amps switch	3	Each		
b	3 pin 5/6 Amp socket outlet	3	Each		
c	15/16 Amps switch	2	Each		
d	6pin 15/16 Amps (universal) socket outlet	2	Each		
4	<b>S/F PVC conduit:</b>				
	Supplying and fixing of following sizes of medium class PVC conduit/Casing Cap G along with accessories in surface/recess including cutting the wall and making good the same in case of recessed conduit as required.(ISI Make)				
a	20 mm	200	Metre		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Installation Testing &amp; Commissioning</b>					
5	<b>ITC Fluorescent fitting directly on surface:</b> Installation, testing and commissioning of pre-wired, fluorescent fitting / compact fluorescent fitting/LED of all types, complete with all accessories and tube etc. directly on ceiling/ wall, including connection with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable and earthing etc. as required.	5	Each		
6	<b>ITC Ceiling fan/Wall fan:</b> Installation, testing and commissioning of ceiling fan, including wiring the down rods of standard length (upto 30 cm) with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable etc. as required.	4	Each		
7	Supplying and fixing two module stepped type electronic fan regulator on the existing modular plate switch box including connections but excluding modular plate etc. as required.	4	Each		
8	Supply of 15W LED tube fitting sleek with decorative end cap, powder coated CRCA steel channel complete with all electrical accessories like electronic ballast, lamp holder, 28W LED lamp etc complete as required. <b>(Philips / Wipro /HAVELLS)</b>	12	Each		
9	Supply and installation of 18 W CFL with its all accessories.[ISI MAKE]	18	Each		
10	Supply and installation of wall fan, white colour, 5 star rated as per BEE complete with blades, casing , wall mounting accessories etc(Make Havells/bajaj/usha/V-guard/crompton)	2	Each		
<b>Miscellaneous Items</b>					
11	<b>CABLE SUPPLY</b>				
	Supplying the following PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade as per CPWD standards as required. <b>(Make:Havells/Glostar/Nicco/Finolex/Polycab)</b>				
	2 X 4 sq. mm + 1 X 4 sq. mm earth wire ( 3 Nos. of 4 Sq.mm wire)	3	Metre		
<b>Sub Total (Electrical Work)</b>					
<b>Total (Civil &amp; Electrical Work)</b>					
<b>GST @ 18%</b>					
<b>Grand Total ( Including GST @ 18%)</b>					

### 3.SCHEDULE OF WORK FOR PRIMARY HEALTH CENTREAT SUDAKA

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Civil Work</b>					
<b>MASONRY WORK</b>					
1	Half brick masonry with common burnt clay F.P.S. (non modular) bricks of class designation 7.5 in superstructure above plinth level up to floor V level. Cement mortar 1:3 (1 cement :3 coarse sand)	3	M.SQ		
<b>FLOORING</b>					
2	Providing and fixing 1st quality ceramic glazed floor tiles conforming to IS : 15622 (thickness to be specified by the manufacturer ) of approved make in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge in skirting, risers of steps and dados over 12 mm thick bed of cement Mortar 1:3 (1 cement: 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
3	Providing and fixing Ist quality ceramic glazed wall tiles conforming to IS: 15622 (thickness to be specified by the manufacturer), of approved make, in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge, in skirting, risers of steps and dados, over 12 mm thick bed of cement mortar 1:3 (1 cement : 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm, including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
<b>PLASTERING</b>					
5	15 mm cement plaster on rough side of single or half brick wall finished with a floating coat of neat cement of mix : 1:3 (1 cement: 3 fine sand)	8	M.SQ		
<b>PAINTING</b>					
6	Distempering with 1st quality acrylic washable distemper (ready made) of approved manufacturer and of required shade and colour complete. as per manufacturer's specification. One or more coats on old work	2592	M.SQ		
7	Painting wood work with Deluxe Multi Surface Paint of required shade. Two or more coat applied @ 0.90 ltr/10 sqm over an under coat of primer applied @0.75 ltr/10 sqm of approved brand and manufacture	26	M.SQ		

<b>Sl.No</b>	<b>Particulars</b>	<b>QTY</b>	<b>UNIT</b>	<b>RATE</b>	<b>AMOUNT</b>
8	Painting Steel work with Deluxe Multi Surface Paint to give an even shade. Two or more coat applied @ 0.90 ltr/ 10 sqm over an under coat of primer applied @ 0.80 ltr/ 10 sqm of approved brand and manufacture	33	<b>M.SQ</b>		
9	Providing and applying plaster of paris putty of 2 mm thickness over plastered surface to prepare the surface even and smooth complete.	248	<b>M.SQ</b>		
10	Removing white or colour wash by scrapping and sand papering and preparing the surface smooth including necessary repairs to scratches etc. complete	4117	<b>M.SQ</b>		
11	Finishing walls with Acrylic Smooth exterior paint of required shade: Old work (Two or more coat applied @ 1.67 ltr/ 10 sqm) on existing cement paint surface	1525	<b>M.SQ</b>		
<b>DISMANTLING</b>					
12	Dismantling plastered brickwalls in cement mortar including cleaning, stacking the useful materials as directed by engineer-in-charge and dumping the dismantled debris as indicated at site, levelling, consolidating, all complete as directed and disposing the debris away from site all complete as directed.	2	<b>M.CUBE</b>		
13	Dismantling the existing RCC concrete including cutting the reinforcement, stacking the useful materials as directed by engineer-in-charge, dumping the dismantled debris as indicated at site, leveling, consolidating, all complete as directed and disposal of debris away from site all complete.	1	<b>M.CUBE</b>		
14	Dismantling Aluminium partition including disposing the debris away from site as directed by engineer in charge all complete.	4	<b>M.SQ</b>		
15	Dismantling of flushing cistern of all types (C.I./PVC/Vitrious China) including stacking of useful materials near the site and disposal of unserviceable materials within 50 metres lead.	1	<b>EACH</b>		
16	Repairs to plaster of thickness 12 mm to 20 mm in patches of area 2.5 sq. meters and under, including cutting the patch in proper shape, raking out joints and preparing and plastering the surface of the walls complete, including disposal of rubbish to the dumping ground, all complete as per directions of Engineer-In-Charge. With cement mortar 1:4 (1cement: 4 coarse sand)	39	<b>M.SQ</b>		

<b>Sl.No</b>	<b>Particulars</b>	<b>QTY</b>	<b>UNIT</b>	<b>RATE</b>	<b>AMOUNT</b>
17	Providing wood work in frames of doors, windows, clerestory windows and other frames, wrought framed and fixed in position with hold fast lugs or with dash fasteners of required dia & length ( hold fast lugs or dash fastener shall be paid for separately). Kiln seasoned and chemically treated hollock wood	<b>0.100</b>	<b>CUM</b>		
18	Providing and fixing ISI marked flush door shutters conforming to IS : 2202 (Part I) non-decorative type, core of block board construction with frame of 1st class hard wood and well matched commercial 3 ply veneering with vertical grains or cross bands and face veneers on both faces of shutters: 35 mm thick including ISI marked Stainless Steel butt hinges with necessary screws	<b>5</b>	<b>M.SQ</b>		
19	Renewing glass panes, with wooden fillets wherever necessary: Float glass panes of thickness 4 mm	<b>12</b>	<b>M.SQ</b>		
20	Providing and applying fibre reinforced elastomeric liquid water proofing membrane with resilient acrylic polymers having Sun Reflectivity Index (SRI) of 105 on top of concrete roof in three coats @10.76 litre/ 10 sqm. One coat of self-priming of elastomeric waterproofing liquid (dilution with water in the ratio of 3:1) and two coats of undiluted elastomeric waterproofing liquid (dry film thickness of complete application/ system not less than 500 microns). The operation shall be carried out after scrapping and properly cleaning the surface to remove loose particles with wire brushes, complete in all respect as per the direction of Engineer-in-Charge.	<b>748</b>	<b>M.SQ</b>		
21	Dismantling Tile Flooring and Walls & Roof and disposing the debris away from site all complete as directed.	<b>42</b>	<b>M.SQ</b>		
<b>DESIGN PRINTED TILES</b>					
22	Providing and laying required size DESIGN PRINTED for display of Logo glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true & even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)  The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)	<b>8</b>	<b>M.SQ</b>		



Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
23	<p>Providing and laying required size DESIGN PRINTED for Windows &amp; Door Borders glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true &amp; even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)</p> <p>The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)</p>	34	M.SQ		
24	Provide all final cleaning including for the Work of assigned Contractors and remove all waste, debris, rubbish, tools, equipment, machinery and surplus materials. Clean all sight exposed surfaces; leave work clean and ready for occupancy.		LS		
<b>PLUMBING</b>					
25	Renewing and repairing plumbing & sanitary items in toilets including making good all damages WC Seat, Gully Trap, Pipe Lines, Flush cistern, flush pipes, PVC pillar taps, PVC Waste Pipes, Pipelines, gate valve and Gratings of approved brand and manufacturer.		LS		
<b>Sub Total (Civil Work)</b>					
<b>Electrical Work</b>					
1	<b>Point wiring in PVC conduit with modular type switch.</b>				
	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable in surface / recessed medium class PVC conduit, with modular switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required. switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required.				
	Group C	14	Point		
2	<b>Wiring through PVC conduit</b>				
	Wiring for circuit/submain wiring along with earth wire with the following sizes of FR PVC insulated copper conductor, single core cable in surface/recessed medium class PVC conduit as required.(Make:Havells/Finolex/V-guard/Polycab)				
a	2X1.5 sq.mm + 1X1.5 sq.mm earth wire	30	Metre		
3	<b>Modular type switch/socket:</b>				

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	Supplying and fixing following modular switch/socket on the existing modular plate & switch box including connections but excluding modular plate etc as required. (Make: Legrand/Havells/HPL)				
a	5/6 Amps switch	3	Each		
b	3 pin 5/6 Amp socket outlet	3	Each		
c	15/16 Amps switch	2	Each		
d	6pin 15/16 Amps (universal) socket outlet	2	Each		
4	<b>S/F PVC conduit:</b>				
	Supplying and fixing of following sizes of medium class PVC conduit/Casing Cap G along with accessories in surface/recess including cutting the wall and making good the same in case of recessed conduit as required.(ISI Make)				
a	20 mm	200	Metre		
	<b>Installation Testing &amp; Commissioning</b>				
5	<b>ITC Fluorescent fitting directly on surface:</b> Installation, testing and commissioning of pre-wired, fluorescent fitting / compact fluorescent fitting/LED of all types, complete with all accessories and tube etc. directly on ceiling/ wall, including connection with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable and earthing etc. as required.	5	Each		
6	<b>ITC Ceiling fan/Wall fan:</b> Installation, testing and commissioning of ceiling fan, including wiring the down rods of standard length (upto 30 cm) with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable etc. as required.	2	Each		
7	Supplying and fixing two module stepped type electronic fan regulator on the existing modular plate switch box including connections but excluding modular plate etc. as required.	2	Each		
8	Supply of 15W LED tube fitting sleek with decorative end cap, powder coated CRCA steel channel complete with all electrical accessories like electronic ballast, lamp holder, 28W LED lamp etc complete as required. <b>(Philips / Wipro /HAVELLS)</b>	12	Each		
9	Supply and installation of 18 W CFL with its all accessories.[ISI MAKE]	18	Each		
10	Supply and installation of wall fan, white colour, 5 star rated as per BEE complete with blades, casing , wall mounting accessories etc(Make Havells/bajaj/usha/V-guard/crompton)	2	Each		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	<b>Miscellaneous Items</b>				
11	<b>CABLE SUPPLY</b>				
	Supplying the following PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade as per CPWD standards as required. <b>(Make:Havells/ Glostar/Nicco/Finolex/Polycab)</b>				
	2 X 4 sq. mm + 1 X 4 sq. mm earth wire ( 3 Nos. of 4 Sq.mm wire)	3	Metre		
	<b>Sub Total (Electrical Work)</b>				
	<b>Total (Civil &amp; Electrical Work)</b>				
	<b>GST @ 18%</b>				
	<b>Grand Total ( Including GST @ 18%)</b>				

**4.SCHEDULE OF WORK FOR PRIMARY HEALTH CENTREAT NAGINA**

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Civil Work</b>					
<b>MASONRY WORK</b>					
1	Half brick masonry with common burnt clay F.P.S. (non modular) bricks of class designation 7.5 in superstructure above plinth level up to floor V level. Cement mortar 1:3 (1 cement :3 coarse sand)	3	M.SQ		
<b>FLOORING</b>					
2	Providing and fixing 1st quality ceramic glazed floor tiles conforming to IS : 15622 (thickness to be specified by the manufacturer ) of approved make in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge in skirting, risers of steps and dados over 12 mm thick bed of cement Mortar 1:3 (1 cement: 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm including pointing in white cement mixed with pigment of matching shade complete.	7	M.SQ		
3	Providing and fixing Ist quality ceramic glazed wall tiles conforming to IS: 15622 (thickness to be specified by the manufacturer), of approved make, in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge, in skirting, risers of steps and dados, over 12 mm thick bed of cement mortar 1:3 (1 cement : 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm, including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
<b>PLASTERING</b>					
4	15 mm cement plaster on rough side of single or half brick wall finished with a floating coat of neat cement of mix : 1:3 (1 cement: 3 fine sand)	8	M.SQ		
<b>PAINTING</b>					
5	Distempering with 1st quality acrylic washable distemper (ready made) of approved manufacturer and of required shade and colour complete. as per manufacturer's specification. One or more coats on old work	2240	M.SQ		
6	Painting wood work with Deluxe Multi Surface Paint of required shade. Two or more coat applied @ 0.90 ltr/10 sqm over an under coat of primer applied @0.75 ltr/10 sqm of approved brand and manufacture	26	M.SQ		
7	Painting Steel work with Deluxe Multi Surface Paint to give an even shade. Two or more coat applied @ 0.90 ltr/ 10 sqm over an under coat of	23	M.SQ		

<b>Sl.No</b>	<b>Particulars</b>	<b>QTY</b>	<b>UNIT</b>	<b>RATE</b>	<b>AMOUNT</b>
	primer applied @ 0.80 ltr/ 10 sqm of approved brand and manufacture				
8	Providing and applying plaster of paris putty of 2 mm thickness over plastered surface to prepare the surface even and smooth complete.	284	<b>M.SQ</b>		
9	Removing white or colour wash by scrapping and sand papering and preparing the surface smooth including necessary repairs to scratches etc. complete	3744	<b>M.SQ</b>		
10	Finishing walls with Acrylic Smooth exterior paint of required shade: Old work (Two or more coat applied @ 1.67 ltr/ 10 sqm) on existing cement paint surface	1464	<b>M.SQ</b>		
<b>DISMANTLING</b>					
11	Dismantling plastered brickwalls in cement mortar including cleaning, stacking the useful materials as directed by engineer-in-charge and dumping the dismantled debris as indicated at site, levelling, consolidating, all complete as directed and disposing the debris away from site all complete as directed.	2	<b>M.CUBE</b>		
12	Dismantling the existing RCC concrete including cutting the reinforcement, stacking the useful materials as directed by engineer-in-charge, dumping the dismantled debris as indicated at site, leveling, consolidating, all complete as directed and disposal of debris away from site all complete.	1	<b>M.CUBE</b>		
13	Dismantling Aluminium partition including disposing the debris away from site as directed by engineer in charge all complete.	4	<b>M.SQ</b>		
14	Dismantling of flushing cistern of all types (C.I./PVC/Vitrious China) including stacking of useful materials near the site and disposal of unserviceable materials within 50 metres lead.	1	<b>EACH</b>		
15	Repairs to plaster of thickness 12 mm to 20 mm in patches of area 2.5 sq. meters and under, including cutting the patch in proper shape, raking out joints and preparing and plastering the surface of the walls complete, including disposal of rubbish to the dumping ground, all complete as per directions of Engineer-In-Charge. With cement mortar 1:4 (1cement: 4 coarse sand)	39	<b>M.SQ</b>		

<b>Sl.No</b>	<b>Particulars</b>	<b>QTY</b>	<b>UNIT</b>	<b>RATE</b>	<b>AMOUNT</b>
16	Providing wood work in frames of doors, windows, clerestory windows and other frames, wrought framed and fixed in position with hold fast lugs or with dash fasteners of required dia & length ( hold fast lugs or dash fastener shall be paid for separately). Kiln seasoned and chemically treated hollock wood	0.100	CUM		
17	Providing and fixing ISI marked flush door shutters conforming to IS : 2202 (Part I) non-decorative type, core of block board construction with frame of 1st class hard wood and well matched commercial 3 ply veneering with vertical grains or cross bands and face veneers on both faces of shutters: 35 mm thick including ISI marked Stainless Steel butt hinges with necessary screws	5	M.SQ		
18	Renewing glass panes, with wooden fillets wherever necessary: Float glass panes of thickness 4 mm	12	M.SQ		
19	Providing and applying fibre reinforced elastomeric liquid water proofing membrane with resilient acrylic polymers having Sun Reflectivity Index (SRI) of 105 on top of concrete roof in three coats @10.76 litre/ 10 sqm. One coat of self-priming of elastomeric waterproofing liquid (dilution with water in the ratio of 3:1) and two coats of undiluted elastomeric waterproofing liquid (dry film thickness of complete application/ system not less than 500 microns). The operation shall be carried out after scrapping and properly cleaning the surface to remove loose particles with wire brushes, complete in all respect as per the direction of Engineer-in-Charge.	450	M.SQ		
20	Dismantling Tile Flooring and Walls & Roof and disposing the debris away from site all complete as directed.	42	M.SQ		
<b>DESIGN PRINTED TILES</b>					
21	Providing and laying required size DESIGN PRINTED for display of Logo glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true & even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)  The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)	8	M.SQ		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
22	<p>Providing and laying required size DESIGN PRINTED for Windows &amp; Door Borders glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true &amp; even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)</p> <p>The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)</p>	34	M.SQ		
23	Provide all final cleaning including for the Work of assigned Contractors and remove all waste, debris, rubbish, tools, equipment, machinery and surplus materials. Clean all sight exposed surfaces; leave work clean and ready for occupancy.		LS		
<b>PLUMBING</b>					
24	Renewing and repairing plumbing & sanitary items in toilets including making good all damages WC Seat, Gully Trap, Pipe Lines, Flush cistern, flush pipes, PVC pillar taps, PVC Waste Pipes, Pipelines, gate valve and Gratings of approved brand and manufacturer.		LS		
<b>Sub Total (Civil Work)</b>					
1	<b>Point wiring in PVC conduit with modular type switch.</b>				
	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable in surface / recessed medium class PVC conduit, with modular switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required. switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required.				
	Group C	12	Point		
2	<b>Wiring through PVC conduit</b>				
	Wiring for circuit/submain wiring along with earth wire with the following sizes of FR PVC insulated copper conductor, single core cable in surface/recessed medium class PVC conduit as required.(Make:Havells/Finolex/V-guard/Polycab)				
a	2X1.5 sq.mm + 1X1.5 sq.mm earth wire	30	Metre		
3	<b>Modular type switch/socket:</b>				

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	Supplying and fixing following modular switch/socket on the existing modular plate & switch box including connections but excluding modular plate etc as required. (Make: Legrand/Havells/HPL)				
a	5/6 Amps switch	3	Each		
b	3 pin 5/6 Amp socket outlet	3	Each		
c	15/16 Amps switch	2	Each		
d	6pin 15/16 Amps (universal) socket outlet	2	Each		
4	<b>S/F PVC conduit:</b>				
	Supplying and fixing of following sizes of medium class PVC conduit/Casing Cap G along with accessories in surface/recess including cutting the wall and making good the same in case of recessed conduit as required.(ISI Make)				
a	20 mm	200	Metre		
	<b>Installation Testing &amp; Commissioning</b>				
5	<b>ITC Fluorescent fitting directly on surface:</b> Installation, testing and commissioning of pre-wired, fluorescent fitting / compact fluorescent fitting/LED of all types, complete with all accessories and tube etc. directly on ceiling/ wall, including connection with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable and earthing etc. as required.	5	Each		
6	<b>ITC Ceiling fan/Wall fan:</b> Installation, testing and commissioning of ceiling fan, including wiring the down rods of standard length (upto 30 cm) with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable etc. as required.	4	Each		
7	Supplying and fixing two module stepped type electronic fan regulator on the existing modular plate switch box including connections but excluding modular plate etc. as required.	4	Each		
8	Supply of 15W LED tube fitting sleek with decorative end cap, powder coated CRCA steel channel complete with all electrical accessories like electronic ballast, lamp holder, 28W LED lamp etc complete as required. <b>(Philips / Wipro /HAVELLS)</b>	12	Each		
9	Supply and installation of 18 W CFL with its all accessories.[ISI MAKE]	18	Each		
10	Supply and installation of wall fan, white colour, 5 star rated as per BEE complete with blades, casing , wall mounting accessories etc(Make Havells/bajaj/usha/V-guard/crompton)	2	Each		



Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	<b>Miscellaneous Items</b>				
11	<b>CABLE SUPPLY</b>				
	Supplying the following PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade as per CPWD standards as required. (Make:Havells/Glostar/Nicco/Finolex/Polycab)				
	2 X 4 sq. mm + 1 X 4 sq. mm earth wire ( 3 Nos. of 4 Sq.mm wire)	3	Metre		
	<b>Sub Total (Electrical Work)</b>				
	<b>Total (Civil &amp; Electrical Work)</b>				
	<b>GST @ 18%</b>				
	<b>Grand Total ( Including GST @ 18%)</b>				

**5. SCHEDULE OF WORK FOR PRIMARY HEALTH CENTREAT BIWAN**

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
<b>Civil Work</b>					
<b>MASONRY WORK</b>					
1	Half brick masonry with common burnt clay F.P.S. (non modular) bricks of class designation 7.5 in superstructure above plinth level up to floor V level. Cement mortar 1:3 (1 cement :3 coarse sand)	3	M.SQ		
<b>FLOORING</b>					
2	Providing and fixing 1st quality ceramic glazed floor tiles conforming to IS : 15622 (thickness to be specified by the manufacturer ) of approved make in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge in skirting, risers of steps and dados over 12 mm thick bed of cement Mortar 1:3 (1 cement: 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm including pointing in white cement mixed with pigment of matching shade complete.	7	M.SQ		
3	Providing and fixing Ist quality ceramic glazed wall tiles conforming to IS: 15622 (thickness to be specified by the manufacturer), of approved make, in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge, in skirting, risers of steps and dados, over 12 mm thick bed of cement mortar 1:3 (1 cement : 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm, including pointing in white cement mixed with pigment of matching shade complete.	10	M.SQ		
<b>PLASTERING</b>					
4	15 mm cement plaster on rough side of single or half brick wall finished with a floating coat of neat cement of mix : 1:3 (1 cement: 3 fine sand)	8	M.SQ		
<b>PAINTING</b>					
5	Distempering with 1st quality acrylic washable distemper (ready made) of approved manufacturer and of required shade and colour complete. as per manufacturer's specification. One or more coats on old work	2280	M.SQ		
6	Painting wood work with Deluxe Multi Surface Paint of required shade. Two or more coat applied @ 0.90 ltr/10 sqm over an under coat of primer applied @0.75 ltr/10 sqm of approved brand and manufacture	26	M.SQ		

<b>Sl.No</b>	<b>Particulars</b>	<b>QTY</b>	<b>UNIT</b>	<b>RATE</b>	<b>AMOUNT</b>
7	Painting Steel work with Deluxe Multi Surface Paint to give an even shade. Two or more coat applied @ 0.90 ltr/ 10 sqm over an under coat of primer applied @ 0.80 ltr/ 10 sqm of approved brand and manufacture	23	<b>M.SQ</b>		
8	Providing and applying plaster of paris putty of 2 mm thickness over plastered surface to prepare the surface even and smooth complete.	284	<b>M.SQ</b>		
9	Removing white or colour wash by scrapping and sand papering and preparing the surface smooth including necessary repairs to scratches etc. complete	3936	<b>M.SQ</b>		
10	Finishing walls with Acrylic Smooth exterior paint of required shade: Old work (Two or more coat applied @ 1.67 ltr/ 10 sqm) on existing cement paint surface	1656	<b>M.SQ</b>		
<b>DISMANTLING</b>					
11	Dismantling plastered brickwalls in cement mortar including cleaning, stacking the useful materials as directed by engineer-in-charge and dumping the dismantled debris as indicated at site, levelling, consolidating, all complete as directed and disposing the debris away from site all complete as directed.	2	<b>M.CUBE</b>		
12	Dismantling the existing RCC concrete including cutting the reinforcement, stacking the useful materials as directed by engineer-in-charge, dumping the dismantled debris as indicated at site, leveling, consolidating, all complete as directed and disposal of debris away from site all complete.	1	<b>M.CUBE</b>		
13	Dismantling Aluminium partition including disposing the debris away from site as directed by engineer in charge all complete.	4	<b>M.SQ</b>		
14	Dismantling of flushing cistern of all types (C.I./PVC/Vitrious China) including stacking of useful materials near the site and disposal of unserviceable materials within 50 metres lead.	1	<b>EACH</b>		
15	Repairs to plaster of thickness 12 mm to 20 mm in patches of area 2.5 sq. meters and under, including cutting the patch in proper shape, raking out joints and preparing and plastering the surface of the walls complete, including disposal of rubbish to the dumping ground, all complete as per directions of Engineer-In-Charge. With cement mortar 1:4 (1cement: 4 coarse sand)	20	<b>M.SQ</b>		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
16	Providing wood work in frames of doors, windows, clerestory windows and other frames, wrought framed and fixed in position with hold fast lugs or with dash fasteners of required dia & length ( hold fast lugs or dash fastener shall be paid for separately). Kiln seasoned and chemically treated hollock wood	0.100	CUM		
17	Providing and fixing ISI marked flush door shutters conforming to IS : 2202 (Part I) non-decorative type, core of block board construction with frame of 1st class hard wood and well matched commercial 3 ply veneering with vertical grains or cross bands and face veneers on both faces of shutters: 35 mm thick including ISI marked Stainless Steel butt hinges with necessary screws	10	M.SQ		
18	Renewing glass panes, with wooden fillets wherever necessary: Float glass panes of thickness 4 mm	12	M.SQ		
19	Providing and applying fibre reinforced elastomeric liquid water proofing membrane with resilient acrylic polymers having Sun Reflectivity Index (SRI) of 105 on top of concrete roof in three coats @10.76 litre/ 10 sqm. One coat of self-priming of elastomeric waterproofing liquid (dilution with water in the ratio of 3:1) and two coats of undiluted elastomeric waterproofing liquid (dry film thickness of complete application/ system not less than 500 microns). The operation shall be carried out after scrapping and properly cleaning the surface to remove loose particles with wire brushes, complete in all respect as per the direction of Engineer-in-Charge.	745	M.SQ		
20	Dismantling Tile Flooring and Walls & Roof and disposing the debris away from site all complete as directed.	42	M.SQ		
<b>DESIGN PRINTED TILES</b>					
21	Providing and laying required size DESIGN PRINTED for display of Logo glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true & even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)  The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)	8	M.SQ		



Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
22	<p>Providing and laying required size DESIGN PRINTED for Windows &amp; Door Borders glazed tiles of printed series(Satin finish) in dado set in CM 1:3 with joints so as to form a true &amp; even surface and joints finished neatly with white cement mixed with matching pigments all complete as directed. (Rate should include base plastering with CM 1:5 of required thickness.)</p> <p>The rate shall include cost of customized printing at top of the tile all complete as the details given by National Health Mission Haryana / HLL directed. (Kindly refer tender documents for Design details)</p>	34	M.SQ		
23	Provide all final cleaning including for the Work of assigned Contractors and remove all waste, debris, rubbish, tools, equipment, machinery and surplus materials. Clean all sight exposed surfaces; leave work clean and ready for occupancy.		LS		
<b>PLUMBING</b>					
24	Renewing and repairing plumbing & sanitary items in toilets including making good all damages WC Seat, Gully Trap, Pipe Lines, Flush cistern, flush pipes, PVC pillar taps, PVC Waste Pipes, Pipelines, gate valve and Gratings of approved brand and manufacturer.		LS		
<b>Sub Total (Civil Work)</b>					
<b>Electrical Work</b>					
1	<b>Point wiring in PVC conduit with modular type switch.</b>				
	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable in surface / recessed medium class PVC conduit, with modular switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required. switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable etc. as required.				
	Group C	12	Point		
2	<b>Wiring through PVC conduit</b>				
	Wiring for circuit/submain wiring along with earth wire with the following sizes of FR PVC insulated copper conductor, single core cable in surface/recessed medium class PVC conduit as required.(Make:Havells/Finolex/V-guard/Polycab)				

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
a	2X1.5 sq.mm + 1X1.5 sq.mm earth wire	30	Metre		
3	<b>Modular type switch/socket:</b>				
	Supplying and fixing following modular switch/socket on the existing modular plate & switch box including connections but excluding modular plate etc as required. (Make: Legrand/Havells/HPL)				
a	5/6 Amps switch	3	Each		
b	3 pin 5/6 Amp socket outlet	3	Each		
c	15/16 Amps switch	2	Each		
d	6pin 15/16 Amps (universal) socket outlet	2	Each		
4	<b>S/F PVC conduit:</b>				
	Supplying and fixing of following sizes of medium class PVC conduit/Casing Cap G along with accessories in surface/recess including cutting the wall and making good the same in case of recessed conduit as required.(ISI Make)				
a	20 mm	200	Metre		
	<b>Installation Testing &amp; Commissioning</b>				
5	<b>ITC Fluorescent fitting directly on surface:</b> Installation, testing and commissioning of pre-wired, fluorescent fitting / compact fluorescent fitting/LED of all types, complete with all accessories and tube etc. directly on ceiling/wall, including connection with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable and earthing etc. as required.	5	Each		
6	<b>ITC Ceiling fan/Wall fan:</b> Installation, testing and commissioning of ceiling fan, including wiring the down rods of standard length (upto 30 cm) with 1.5 sq. mm FR PVC insulated, copper conductor, single core cable etc. as required.	4	Each		
7	Supplying and fixing two module stepped type electronic fan regulator on the existing modular plate switch box including connections but excluding modular plate etc. as required.	4	Each		
8	Supply of 15W LED tube fitting sleek with decorative end cap, powder coated CRCA steel channel complete with all electrical accessories like electronic ballast, lamp holder, 28W LED lamp etc complete as required. ( <b>Philips / Wipro /HAVELLS</b> )	12	Each		
9	Supply and installation of 18 W CFL with its all accessories.[ISI MAKE]	18	Each		
10	Supply and installation of wall fan, white colour, 5 star rated as per BEE complete with blades, casing , wall mounting accessories etc(Make Havells/bajaj/usha/V-guard/crompton)	2	Each		

Sl.No	Particulars	QTY	UNIT	RATE	AMOUNT
	<b>Miscellaneous Items</b>				
11	<b>CABLE SUPPLY</b>				
	Supplying the following PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade as per CPWD standards as required. (Make:Havells/ Glostar/Nicco/Finolex/Polycab)				
	2 X 4 sq. mm + 1 X 4 sq. mm earth wire ( 3 Nos. of 4 Sq.mm wire)	3	Metre		
	<b>Sub Total (Electrical Work)</b>				
	<b>Total (Civil &amp; Electrical Work)</b>				
	<b>GST @ 18%</b>				
	<b>Grand Total ( Including GST @ 18%)</b>				

**DESIGN**

1) **BORDER**

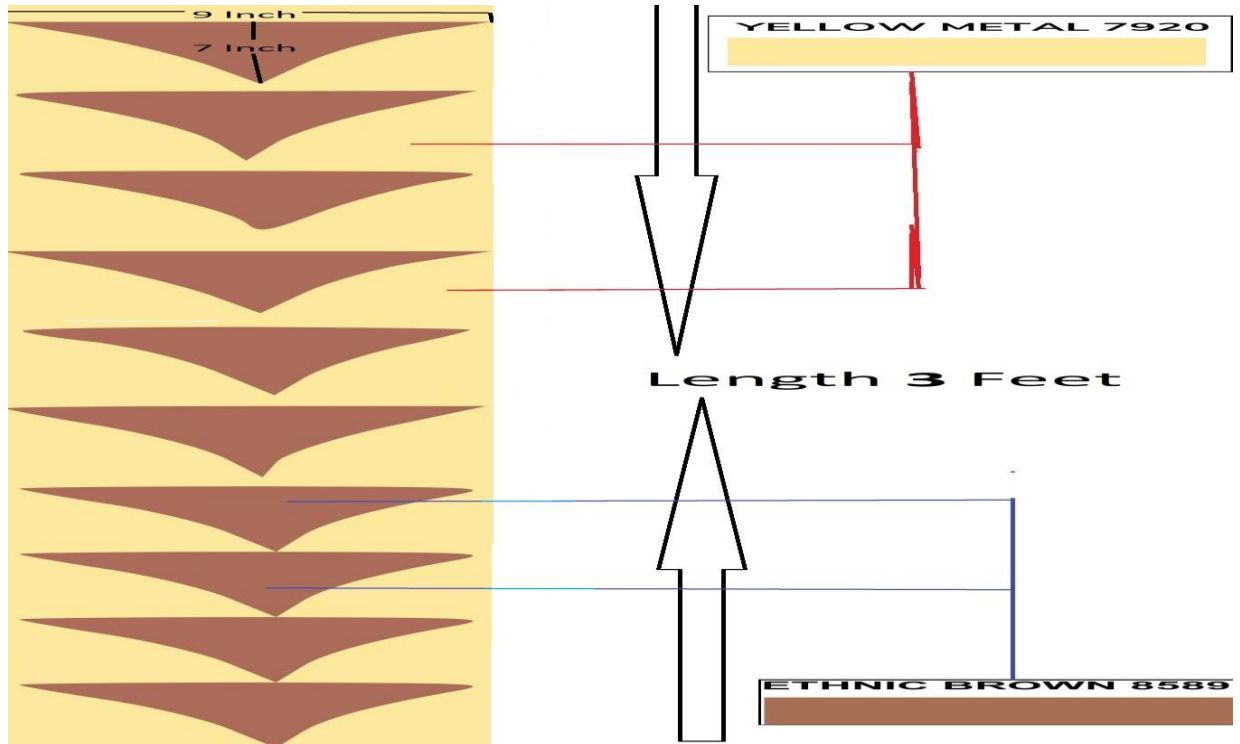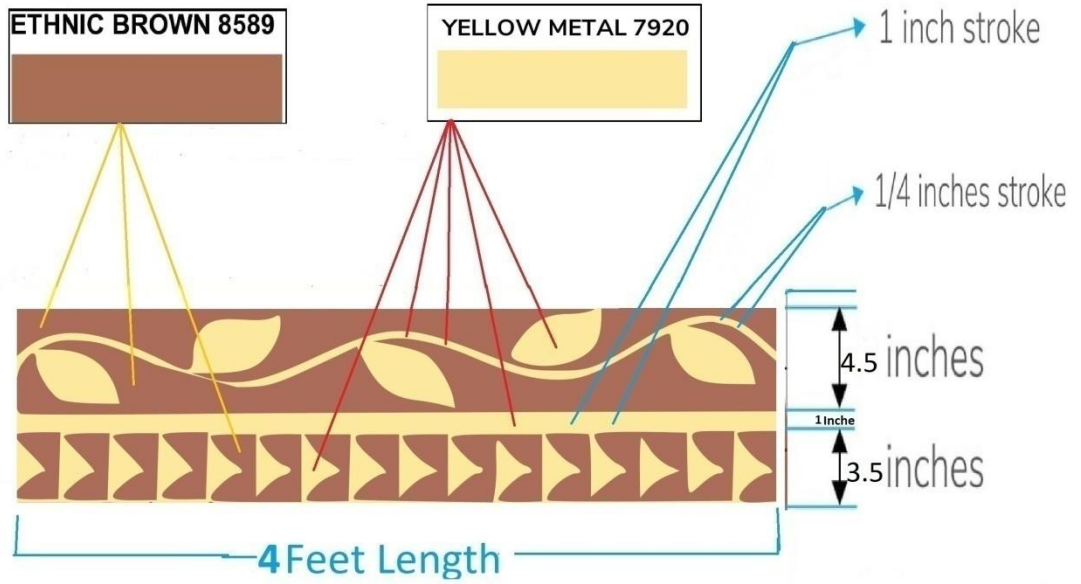



All Measurements in Feet

10.00'



NATIONAL HEALTH MISSION  
राष्ट्रीय स्वास्थ्य मिशन

# आयुष्मान भारत

## हेल्थ वेलनेस सेंटर



2)