ITEM NO.	DESCRIPTION	QUANTITY
1.	100Ømm DIAMETER MEDIUM DUTY GI PIPE	3 METERS
2.	GALAVANISED MILD STEEL FLATBAR (DETAIL "B")	1 EACH
3.	CONCRETE INSPECTION PIT AND 5 mm MS CHEQUERED PLATE	1 EACH

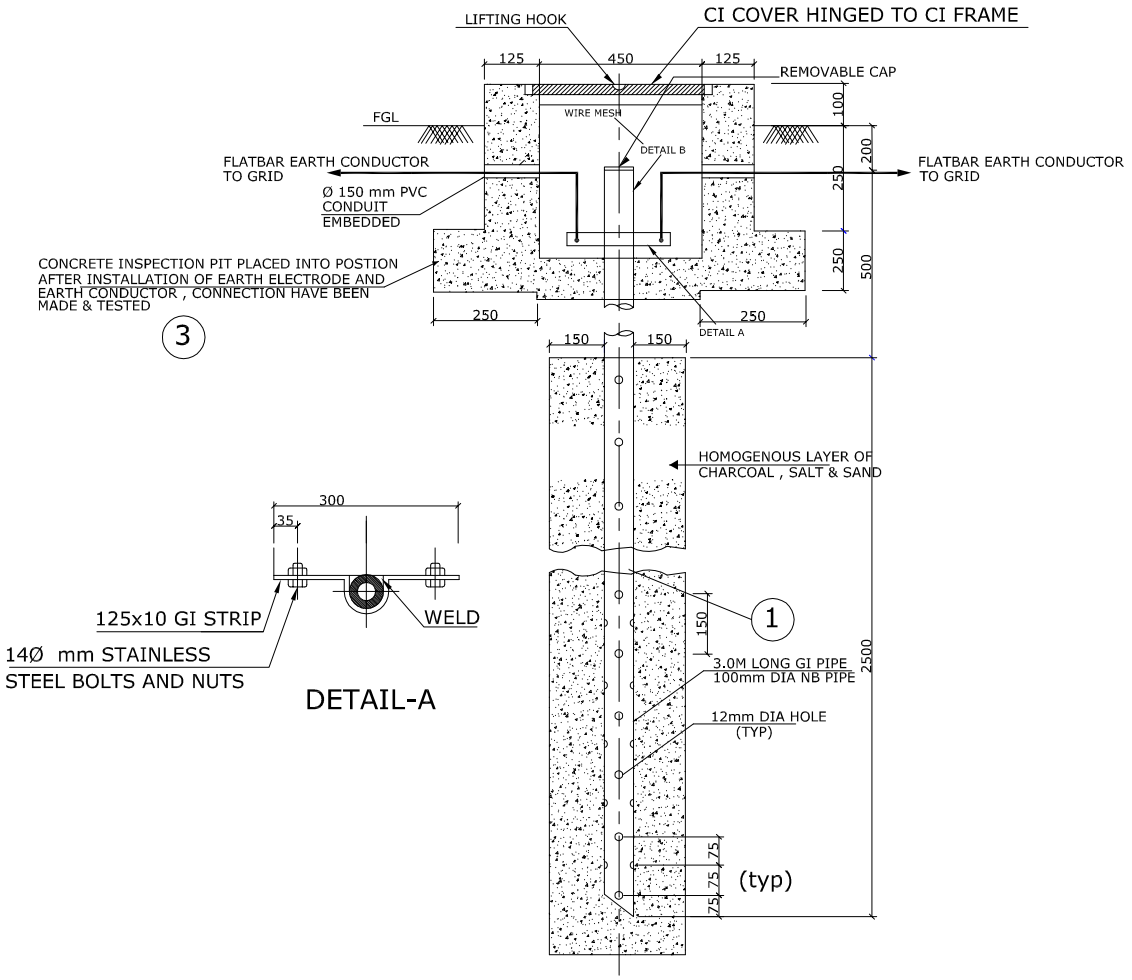

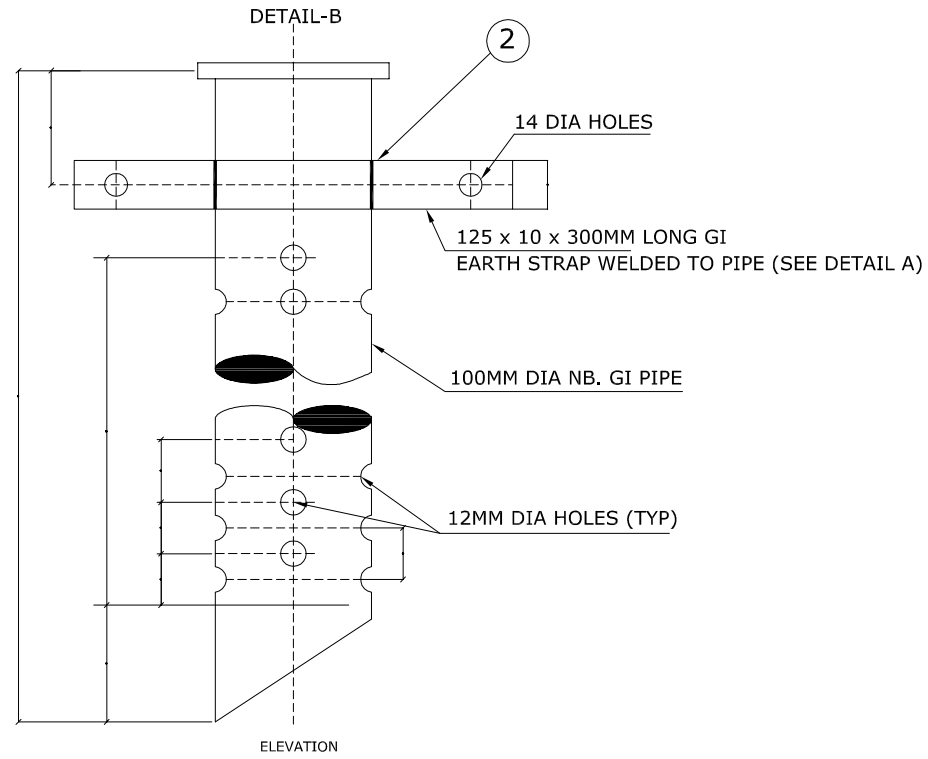

TYPICAL ARRANGMENT OF TREATED PIPE EARTH ELECTRODE DETAILS

NOTES:-

1. EARTH PIT SHALL BE ATLEAST 2M. AWAY FROM BUILDING WALLS.
2. THE DISTANCE BETWEEN EARTH PITS SHALL BE MINIMUM OF 3M.
3. ALL DIMENSION ARE IN MILLIMETERS (mm)
4. ALL NUT , BOLT AND WASHER SHALL BE GALVANISED OR ZINC PASSIVATED.
5. INSPECTION PITS SHALL BE INSTALLED 100mm ABOVE (FGL) SURROUNDING GRADE WITH IN PAVED AREAS.
6. INSPECTION PIT No TO BE PAINTED ON COVER , GREEAN BASE AND WHITE LETTERS.
7. ALL STEEL WORK SHALL BE HOT DIP GALVANISED.
8. ALL DAMAGE TO GALAVANISED FINISHES SHALL BE MADE GOOD WITH ZINC RICH PAINT.

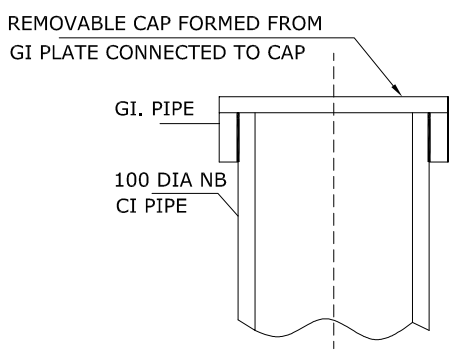

Rev.	Date	Changed	Checked	Kind of revision	No. Of Prints	Date	Issued To

File name :

Project: INTEGRATED VACCINES COMPLEX, HLL BIOTECH LIMITED,

Project No.: 120310

Location: CHENGALPATTU

Description: TYPICAL DRAWING FOR GI PIPE EARTH ELECTRODES

nne pharmaplan
NNE Pharmaplan India Limited
#12, Achiah Shetty Layout,
Bangalore - 560 080., INDIA.

	Date	Name
Drawn	26.04.2014	NVKK
Checked	26.04.2014	BAKD
Approved	26.04.2014	VNIR
Scale-NTS	Units : mm	Size : A4

Drawing no: NPI/120310/ELC(STD)/S1/03 Rev. 00

THE INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND NOT FOR PUBLICATION. BEING THE PROPERTY OF NNE PHARMAPLAN INDIA LIMITED. THE INFORMATION IS ISSUED ON THE UNDERSTANDING THAT NO PART THERE OF SHALL BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT AUTHORISATION IN WRITING FROM NNE PHARMAPLAN INDIA LIMITED.